


WBAR

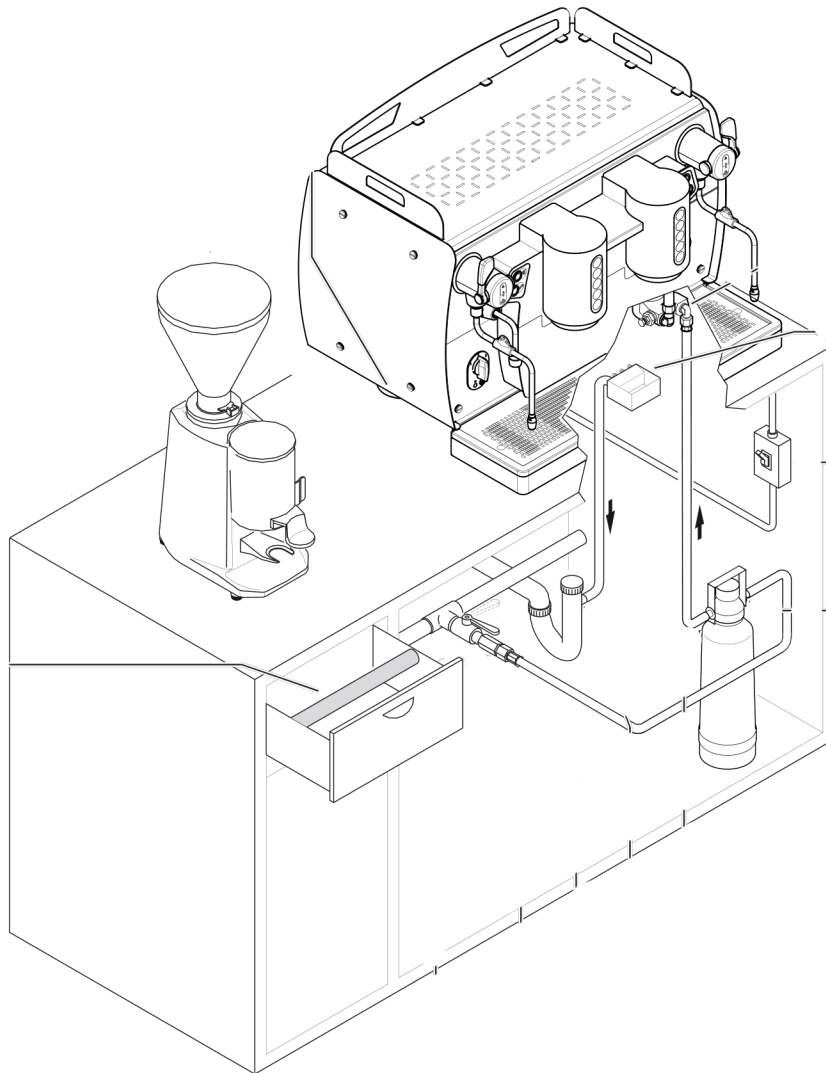

Water Requirements

- 3/8" dedicated cold water line with shut off valve and compression fitting.
- Water hardness cannot exceed 3gpg or 50ppm.
- Water softener must be installed if it exceeds the limits.
- Minimum incoming water flow rate of 35 GPH and the maximum line pressure of 70 PSI/5 BAR

Drain Requirements

Open gravity drain of minimum 1.25 inch within 4 feet of the machine

220 volt/16.8 amps



Nema L6-30

